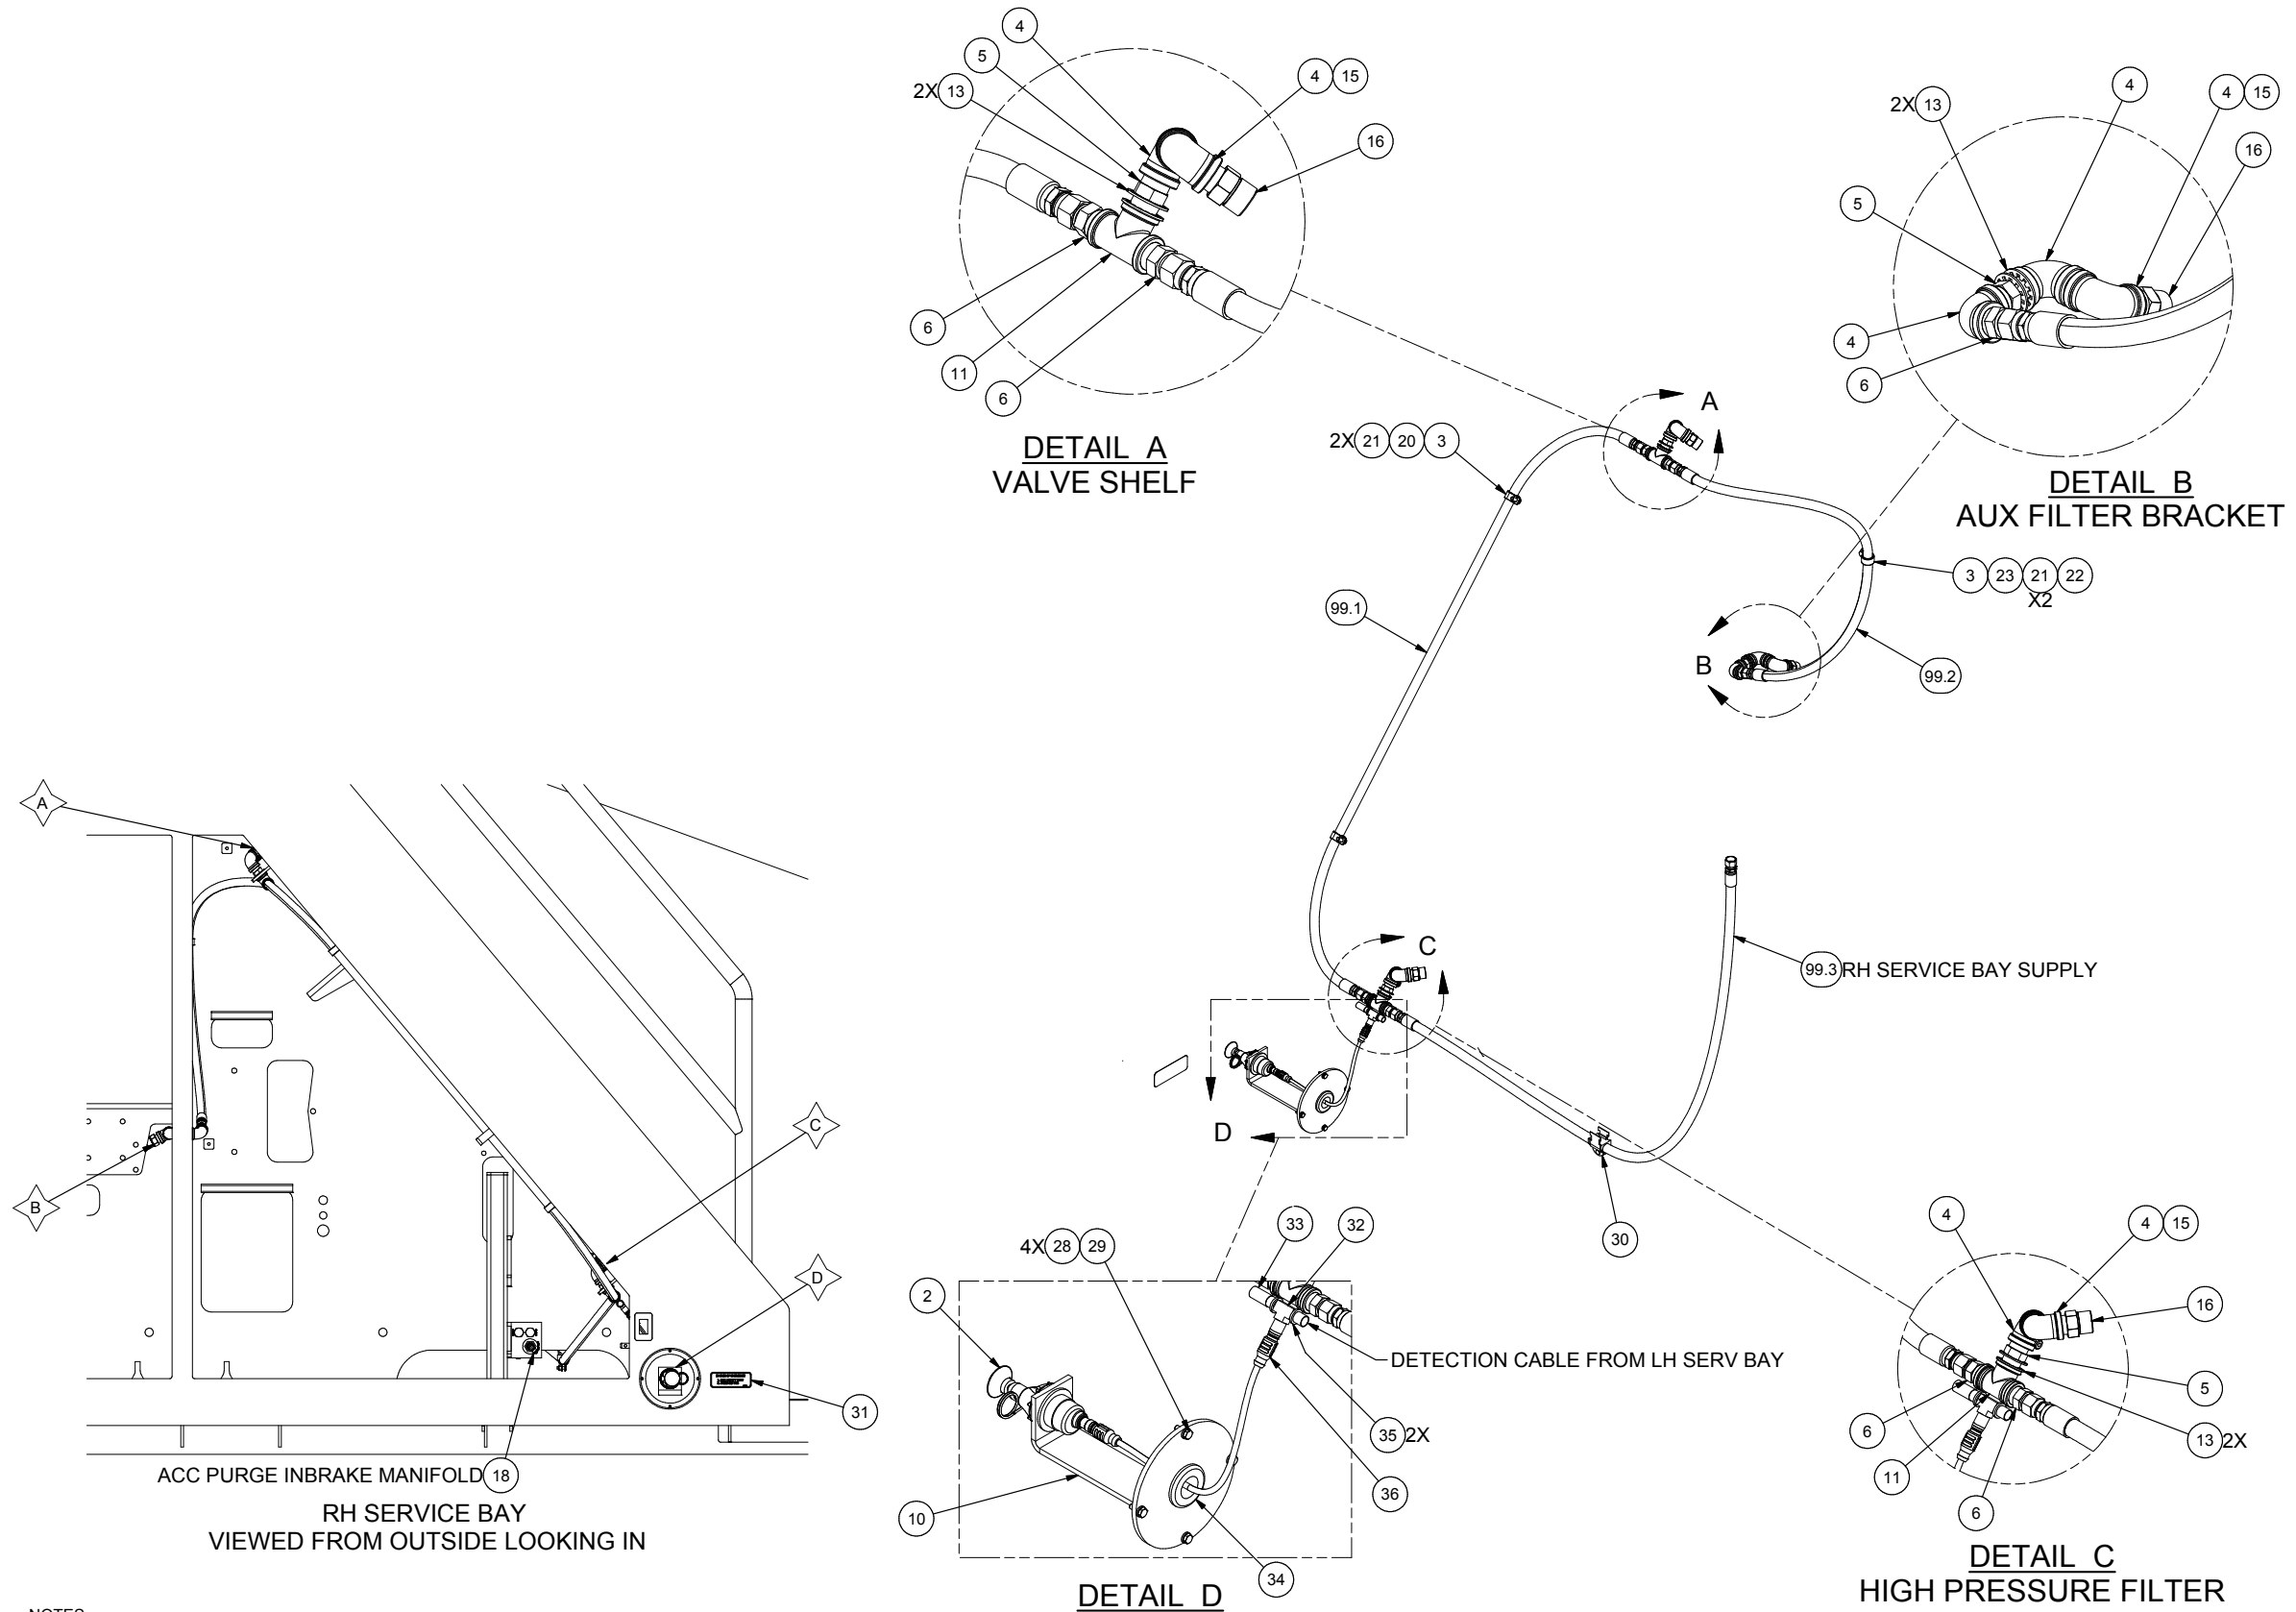

**Fire Suppression, RH Bay, Auto,
Components**

Fire Suppression, RH Bay, Auto, Components

Item	Part No.	Qty	Description	Item	Part No.	Qty	Description
	594829		Fire Suppr, Rh Bay, Auto, Cmnpts				
2	-----	1	. Actuator	24	590087	1RL	. Tape
3	R13808097	3	. Clip	25	-----	0	. Cap, Blow-Off
4	249732	7	. Elbow, Pipe	26	Y27E-14	1	. Washer
5	209161	3	. Fitting	27	YHGB 06	1'	. Hose Guard
6	209633	5	. Fitting	28	296417W	4	. Washer
10	594346	1	. Weldment, Actuator Ema	29	Y09C-M0616	4	. Capscrew
11	249733	2	. Tee, Pipe	30	231537	1	. Clamp
13	-----	6	. Lockwasher	31	539197	1	. Decal, Fire Extinguisher
15	589926	3	. Nipple, Pipe	32	-----	1	. Connector, Tee
16	-----	3	. Kit, Nozzle	33	-----	1	. Connector, Eol Divice
18	209486	1	. Fitting	34	239083	1	. Grommet
20	293613W	2	. Capscrew	35	249329	2	. Cable Tie, Dbl Loop
21	296418W	4	. Hard Washer	36	-----	1	. Cable, Detection Ckt
22	302400W	1	. Locknut	99	595476	1	. Kit, Hose
23	R13809366	1	. Capscrew	99.1	258557	1	. . Hose Assembly
				99.2	588274	1	. . Hose Assembly
				99.3	588235	1	. . Hose Assembly

Fire Suppression System should be serviced
by an authorized ANSUL service technician.



NOTES:

1. ITEMS 24, 25, 26, & 27 ARE NOT SHOWN. ITEM 25 COMES WITH NOZZLE KIT, ITEM 26 IS TO BE USED WHEN THREADS BOTTOMS OUT WHEN ATTACHING FITTINGS TO NOZZLE BRACKET. ITEM 27 IS USED WHEN PASSING HOSE THROUGH OR AROUND ANY SHARP EDGES OF DECK OR BULKHEAD.
2. ITEM 24 IS TO BE USED ON ALL THREADED PIPE CONNECTIONS. DO NOT ALLOW TAPE ON THE INSIDE OF CONNECTIONS. THE USE OF LIQUID SEALANTS IS NOT APPROVED BY ANSUL.
3. ANSUL RECOMMENDS THE FOLLOWING BEND RADII: FOR PARKER 426 SERIES OF HOSES
#4 --- 4.00 IN, #8 --- 7.00 IN, #12 --- 9.50 IN.