


Manifold Installation

NOTES:

1 USE PIPE THREAD SEALANT SPARINGLY, GROUND CIRCUIT INTEGRITY MUST REMAIN INTACT FOR SWITCH TO OPERATE;

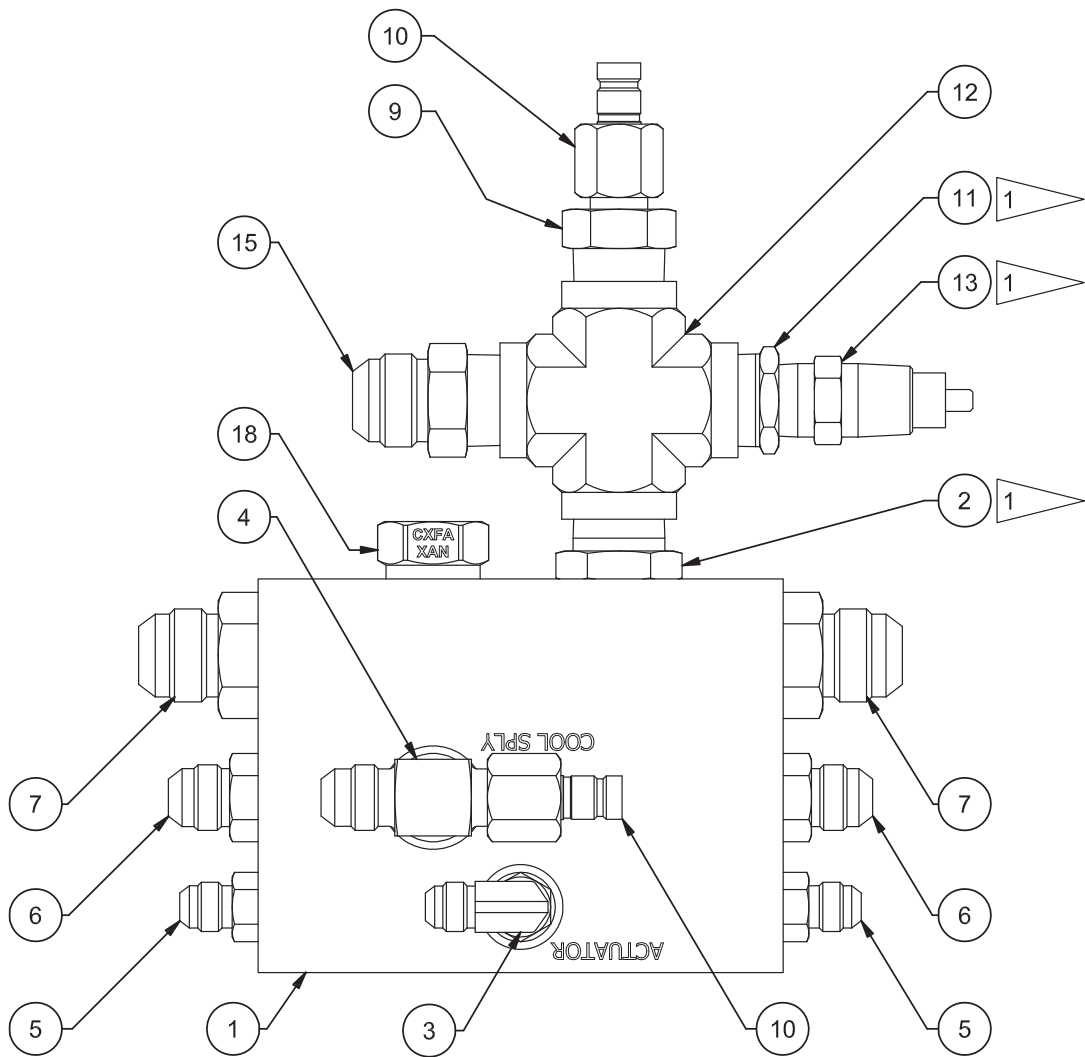

Item	Part No.	Qty	Description	Item	Part No.	Qty	Description
586497				Manifold Installation			
1	583768	1	. Manifold	10	253326	2	. Coupler, Male
2	15303	1	. Fitting	11	209506	1	. Fitting
3	R13801972	1	. Fitting	12	209499	1	. Fitting
4	211551	1	. Fitting	13	254086	1	. Switch, Thermostat
5	211560	2	. Fitting	15	209759	1	. Fitting
6	209805	2	. Fitting	18	243786	1	. Cartridge, Valve
7	209215	2	. Fitting		251170	1	.. Seal Kit
9	209940	1	. Fitting				